

# Relay Coordination in the Protection of Radially-Connected Power System Network

Zankhana Shah

Electrical Department, Kalol institute of research centre, Ahmedabad-Mehshana Highway, kalol, India

[zankhu.shah@gmail.com](mailto:zankhu.shah@gmail.com)

**Abstract**— Protective relays detect intolerable or unwanted conditions within an assigned area, and then trip or open one or more circuit breakers to isolate the problem area before it can damage or otherwise interfere with the effective operation of the rest of the power system. It often happens that a substation feeder relay and supply-side relay both trip for the same feeder fault. This occurrence, known as over-trip is undesirable, and is usually blamed on poor relay coordination. The relay and breaker nearest to the point of fault must be able to see the fault and operate before other relays in the system so that healthy parts of the system will not be interrupted. How to achieve this is the subject of this paper.

**Keywords**— Relay, Fault, Trip, Coordinating Time Interval, Feeder

## I. INTRODUCTION

When a feeder fault causes the supply side relay to trip, not only are the customers on the faulted feeder inconvenienced with an outage, but all the customers that are being served by the other feeders from the same supply-side relay and breaker also experience an outage. Therefore necessary discrimination must be enabled during fault conditions. This can be achieved in the following ways [1]:

- (a) By monitoring only current level - current grading
- (b) By monitoring time delayed operation - time grading.

## II. APPLICATION

### A. Current grading

With reference to figure 1, correct discrimination can be achieved with instantaneous overcurrent relays by setting  $R_2$  at lower current than  $R_1$ . Thus, the current setting of a relay nearer the source must always be higher than the setting of the preceding relay. The current in the feeder between B and C is 500A and the current between A and B is  $200 + 500 = 700$ A. The relays must have current settings which are higher than any current which can flow through the relays under normal conditions i.e. 110% of the rated current. Electronic and microprocessor- based relays have current setting steps of 5% [2], [3].

The current setting of the relay,  $R_2 = \frac{550}{800} = 0.69$ ;

The setting of  $R_1$  should be at least  $\frac{I}{IN} = \frac{770}{800} = 0.96$

If relay  $R_2$  were given a higher setting than  $R_1$  mal-operation would occur in the protection. In any case, in the event of short circuit beyond  $R_2$  downstream, large currents much greater than 800A would flow, and the two relays would trip at the same time. Current grading will therefore not be suitable.

### B. Time grading

Selectivity during fault conditions would be achieved by using relays set to operate after different time delays. The difference in operating times between upstream and downstream relays for discrimination or coordination purposes is called coordinating time interval (CTI). As stated earlier, the goal is to allow enough time for the relay and breaker closest to the fault to clear the fault from the system before the relay associated with the adjacent section nearer to the source could initiate the opening of its circuit breaker. For example, the feeder relay and breaker, which are downstream, should clear a feeder fault before the supply-side relay and breaker (upstream) could trip. Generally, CTI of about 0.4 seconds is allowed. This CTI takes the following into consideration [4]:

- Breaker fault-interruption time is taken as 0.15s.
- Over travel of the induction disk or solid-state relay after the fault current has been interrupted is provided for by 0.1s.
- A safety margin of 0.15s to compensate for possible deviations in calculated fault currents, relay tap selection, relay operating time, and current transformer ratio errors.

## III. GRADING USING RELAYS WITH DEFINITE OPERATING TIMES

Let us illustrate this phenomenon with figure 2 shown below.

Network parameters: G: 2MVA, 10%;  $T_1$ : 2MVA, 11/3.3KV, 7%;  $T_2$ : 500KVA, 3.3/0.415KV, 6%; Lines 1, 2, 3: 0.02 /ph; Line 5: 0.2/ph; Line 8: 0.2/ph; System MVA base = 20MVA; Positive and negative sequence impedances are assumed equal. [1]

In this network, for a fault at the point  $F_1$ , relays  $R_1$ ,  $R_2$  and  $R_3$  must not operate in less than 0.5s. Reactance of  $G = 1p.u$ ; Reactance of  $T1 = 0.7p.u$ ; Reactance of Line 8 =  $0.367p.u$ ; Reactance of Line 5 =  $0.367p.u$ ; Reactance of  $T2 = 2.4p.u$ ; Reactance of Line 1 =  $2.323p.u$ ;

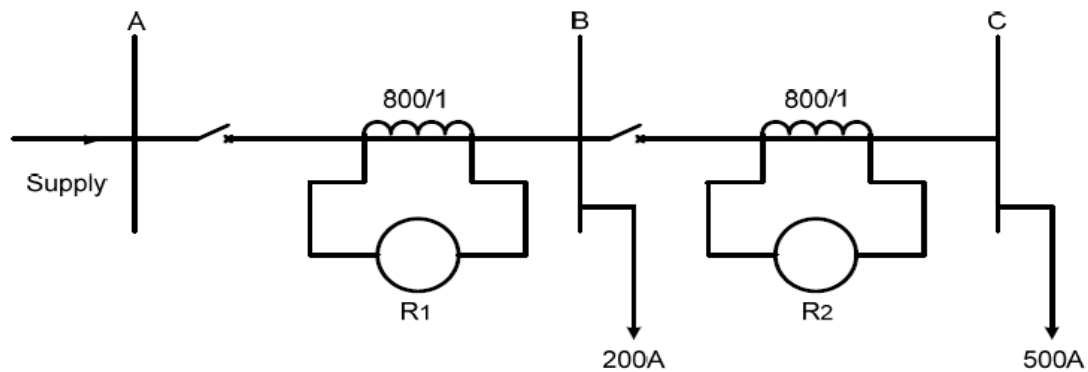


Fig 1. Current discrimination in a radially-connected network

A three-phase fault gives the highest short-circuit current. This current is applied in the settings for the protection to be used [5]. The fault current,  $I$  for three-phase fault at the points are:

$$F_1: I = \frac{1}{7.157} \times \frac{2000}{\sqrt{3} \times 0.415} = 3888 \text{ A}$$

Similarly,  $F_2: I = 5756 \text{ A}$ ,  $F_3: I = 1437 \text{ A}$ ,  $F_4: I = 1693 \text{ A}$ ,  $F_5: I = 2058 \text{ A}$ .

According to the maximum ratings of the lines, and allowing 100% setting, the current settings of the relays should be as follows:  $R_1 = 200 \text{ A}$ ;  $R_5 = 105 \text{ A}$ ;  $R_8 = 280 \text{ A}$ ;  $R_{10} = 105 \text{ A}$ . It can be seen that with instantaneous over-current relays, if current of  $400 \text{ A}$ , for example, due to over-load flows in line1, relay  $R_1$  only will trip, giving correct discrimination. But for fault current of  $3888 \text{ A}$  at point  $F_1$ ,  $R_{10}$  would operate instantly since this is about 1.5 times its setting. This is undesirable. So it is necessary to add time discrimination with time settings increasing towards the source, as shown in figure 3.

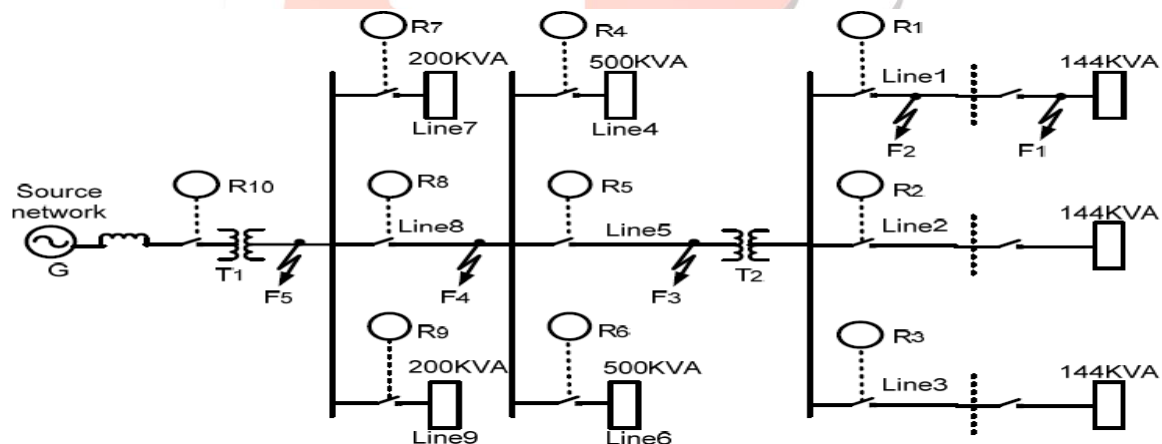


Figure 2 Protection of radially-connected network.

The time settings of the relays are:  $R_1: 0.5 \text{ s}$ ,  $R_5: 0.9 \text{ s}$  and  $R_8: 1.3 \text{ s}$ ;  $R_{10} = 1.7 \text{ s}$ . Thus for the protection of a network containing several sections in series as shown in figure 2, the relay nearest to the source may have unacceptably high operating times for faults in the sections they protect. In other words, the tripping time for a fault near the power source may be dangerously high [6]. This is because the current level associated with such faults is large and destructive, and must be removed very quickly. Therefore relays with definite time lags are suitable for the protection of networks with relatively few series-connected sections only.

#### 2.2.2. Time grading using relays with inverse time/current characteristics

In these relays tripping time is inversely proportional to the current magnitude. We apply inverse definite minimum-time (IDMT)' relay with normal inverse characteristic given as [7]

$$t = \frac{0.14}{\left(\frac{I}{I_s}\right)^{0.02} - 1} \times T_p \quad (1)$$

Where  $t$  = tripping time of relay,  $T_p$  = time multiplier setting (TMS),  $I$  = fault current,  $I_S$  = set pick-up current. So for relay  $R_1$  in figure 2,  $I = 3886A$  (fault at point F1),  $I_S = 200A$ ,  $t = 0.5s$ .

Table 1: Summary of settings.

Relay	$I_S$ (A)	$T_p$
$R_1$	200	0.22
$R_5$	105	0.24
$R_8$	280	0.24
$R_{10}$	105	0.3

Note that it is assumed that  $R_1$  operated in 0.5s to discriminate from the relay which operates in 0.1s [2]. Therefore, from equation (1),  $t = 2:29 T_p$ . So if the relay  $R_1$  is set at 1.0 (TMS), it would operate in 2.29s. However, as  $R_1$  is required to operate in 0.5s,  $T_p$  is equal to 0.22, which is now the relay setting. For three- phase fault at point  $F_2$ ,  $I = 5756A$ . This is the maximum possible short circuit current that can flow in line 1, i.e., the fault level. Therefore the time,  $t$  which relay  $R_1$  takes to interrupt this current is computed as:

$$t = \frac{0.14}{\left(\frac{5756}{200}\right)^{0.02} - 1} \times 0.22 = 0.445$$

So the tripping time of  $R_1$  has now been reduced to 0.44s

For  $R_5$ :

$I_S = 105A$ ,  $t = 0.44 + 0.4 = 0.84s$ ,  $T_p = 0.24$ . The maximum fault current which relay  $R_5$  would have to deal with is 1437A. The operating time of  $R_5$  for this current is  $2.6 \times 0.24 = 0.62s$ .

For  $R_8$ :

$I_S = 280A$ ,  $t = 0.62 + 0.4 = 1.02s$ ,  $T_p = 0.24$ .

The fault current level of line 8 is 1693. The operating time of  $R_8$  for this current is  $3.82 \times 0.24 = 0.92s$ .

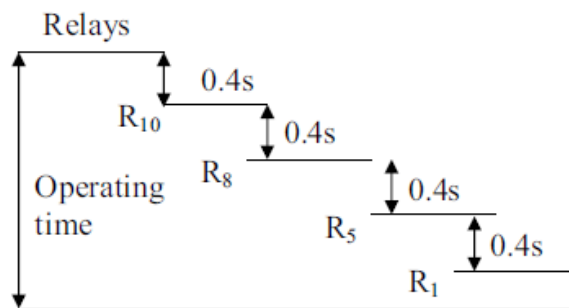


Fig 3 Discrimination achieved with definite-time Overcurrent relay

For  $R_{10}$ :

$I_S = 105A$ ,  $t = 0.92 + 0.4 = 1.31s$ ,  $T_p = 0.3$ .

The maximum fault current that would go through relay  $R_{10}$  is 616A. The operating time of  $R_{10}$  for this current is  $3.9 s \times 0.3 = 1.17s$

Table 2: Fault currents and trip times of relays

Fault location	Fault current I (A)	Trip time T (S)			
		$R_1$	$R_5$	$R_8$	$R_{10}$
$F_1$	3888	0.5	1.07	2.99	6.28
$F_2$	5756	0.44	0.84	1.74	2.87
$F_3$	1437	0.36	0.62	1.02	1.47
$F_4$	1693	0.35	0.58	0.92	1.31
$F_5$	2058	0.34	0.55	0.83	1.17

The tripping times of the relays for the various fault currents are shown in table 2, and the trip time/current curves follow in figures 4a, 4b, 4c and 4d.

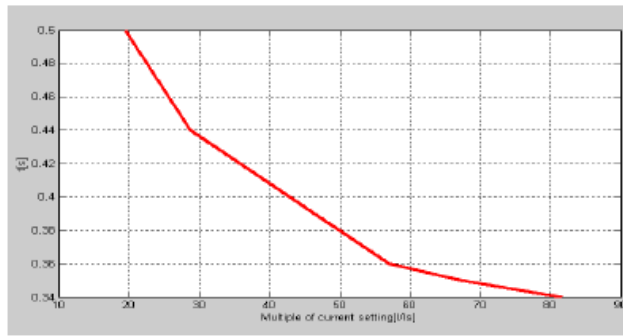
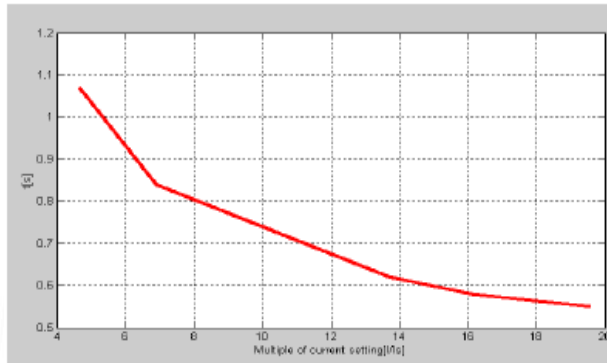
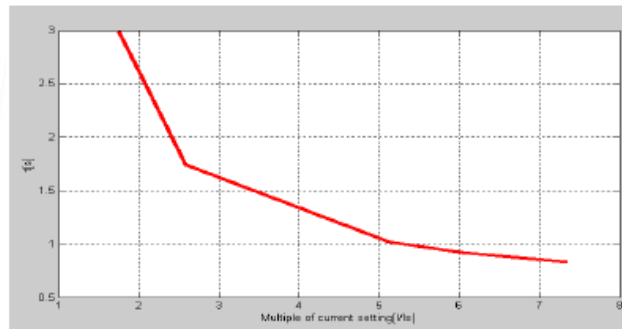
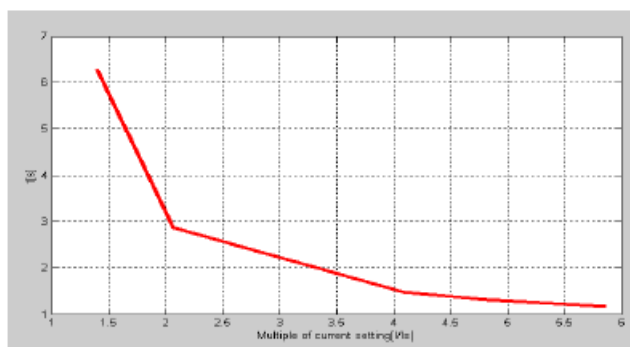
(a) Trip time characteristic of inverse time over-current protection of relay R<sub>1</sub>(b) Trip time characteristic of inverse time over-current protection relay R<sub>5</sub>(c) Trip time characteristic of inverse time over-current protection relay R<sub>8</sub>(d) Trip time characteristic of inverse time over-current protection relay R<sub>10</sub>

Fig.4 a,b,c,d

From the graphs, it is clear that tripping time is inversely proportional to the magnitude of fault current. As fault current increases, trip time decreases.

#### IV. CONCLUSIONS

Obviously, to obtain correct discrimination, relays with inverse time/current characteristics are preferred. They give rapid clearance for large faults and sustained over-loads. Current grading using instantaneous over-current relays have very limited use. They can only be applied where there is abrupt difference in magnitude between fault current within the protected section and fault current outside it. In radial circuits with many sections in series, application of relays with definite operating time results in the tripping time for a fault near the power source being dangerously high.

#### REFERENCES

- [1] C. Christopoulos, A. Wright. Electrical Power System Protection, Kluwer Academic Publishers,
- [2] T. Davies. Protection of Industrial Power Systems, Newnes, 2001.
- [3] Sachdev, M.S. Microprocessor Relays and Protection Systems, IEEE Tutorial Course, 88EH0269- 1-PWR, 1988.
- [4] Michael Ray Russell, Russ Poteet. Transmission and Distribution World, October, 1998.
- [5] B.M. Weedy, Electric Power Systems, John Wiley and Sons, 1975.
- [6] A.R. van C. Warrington, Protective Relays: Their Theory and Practice, Chapman and Hall, 1971.
- [7] 7SJ600 V2 - Siemens Relay Manual.

